

8

7

6

5


4

3

2

1

ZONE	REV	DESCRIPTION	REVISION	DATE	APPROVED

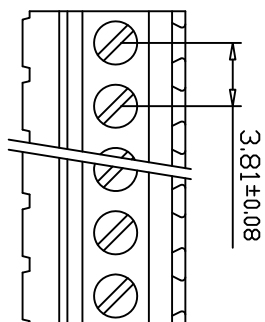



✓	Poles	A±0.30	B±0.20	17	64.77	60.96
02		7.62	3.81	18	68.58	64.77
03		11.43	7.62	↓	Poles	A±0.45 B±0.35
04		15.24	11.43	19	72.39	68.58
05		19.05	15.24	20	76.2	72.39
06		22.86	19.05	21	80.01	76.20
↓	Poles	A±0.35	B±0.25	22	83.82	80.01
07		26.67	22.86	23	87.63	83.82
08		30.48	26.67	24	91.44	87.63
09		34.29	30.48	↓	Poles	A±0.50 B±0.40
10		38.1	34.29	25	95.25	91.44
11		41.91	38.1	26	99.06	95.25
12		45.72	41.91			
↓	Poles	A±0.40	B±0.30			
13		49.53	45.72			
14		53.34	49.53			
15		57.15	53.34			
16		60.96	57.15			

Screws Torque: 1 In-Lb
Wire Range: 12~28 AWG
Rated: 20 Amperes, AC350V
Operation Temperature: -40°C~+105°C
Insulation withstands volt: AC1600V min
Insulation resistance: >2000MΩ DC500V

Part Number:

HD-382-XXP

02~26 Poles

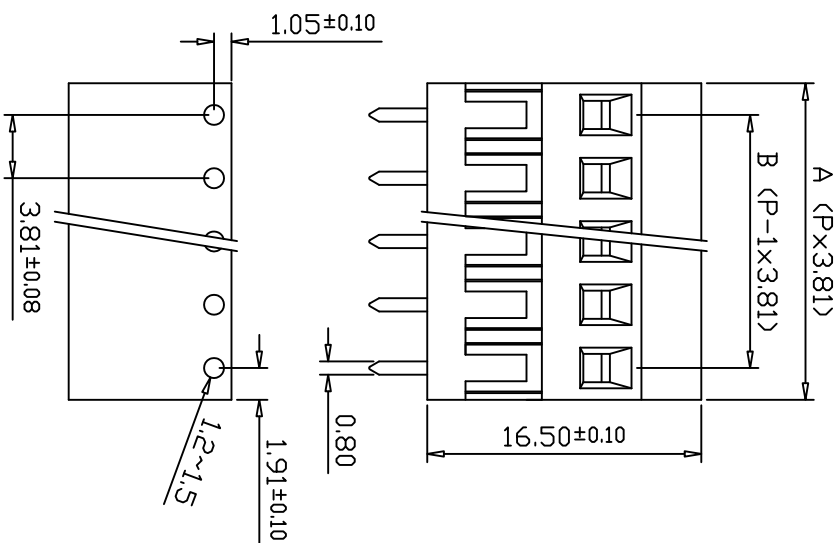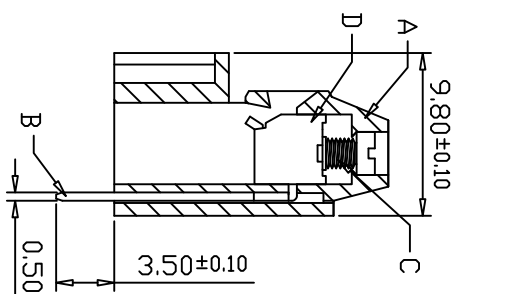

Size update From 7.60 to 7.50
(2018/10/17)

Material		Plating/Finish	Remark
A	Insulating body	PA66 UL 94V-0	Green
B	Terminal	Brass	Tin
C	Screw	Steel	Yellow Zinc
D	Cage Clamp	Brass	Tin
E			



HOW DER
ELECTRONIC CO., LTD

PART NAME
Terminal Blocks

UNIT
MM

REVISION

DESIGN CHECK APPROVED DRAWING NO.

CERTIFIED

MM

SHEET

http://www.howder-tn.com

E-mail:info@howder-tn.com

Tel:886-2-2223-1026

Fax:886-2-2221-6471



DATE

DATE

DATE

CERTIFIED

MM

SHEET

1/1