


ZONE		REV	DESCRIPTION		SHEET	APPROVED






✓	Poles	A±0.30	B±0.20		17	59.5	56.0
	02	7.0	3.5		18	63.0	59.5
	03	10.5	7.0	↑	Poles	A±0.45	B±0.35
	04	14.0	10.5		19	66.5	63.0
	05	17.5	14.0		20	70.0	66.5
	06	21.0	17.5		21	73.5	70.0
↑	Poles	A±0.35	B±0.25		22	77.0	73.5
	07	24.5	21.0		23	80.5	77.0
	08	28.0	24.5		24	84.0	80.5
	09	31.5	28.0	↑	Poles	A±0.50	B±0.40
	10	35.0	31.5		25	87.5	84.0
	11	38.5	35.0		26	91.0	87.5
	12	42.0	38.5				
↑	Poles	A±0.40	B±0.30				
	13	45.5	42.0				
	14	49.0	45.5				
	15	52.5	49.0				
	16	56.0	52.5				

Screws Torque: 1 In-Lb
Wire Range: 12~28 AWG
Rated: 20 Amperes,AC300V
Operation Temperature: -40℃~+105℃
Insulation withstands volt: AC1600V min
Insulation resistance: >2000MΩ DC500V

Part Number:

HD-354-XXP

02~26 Poles

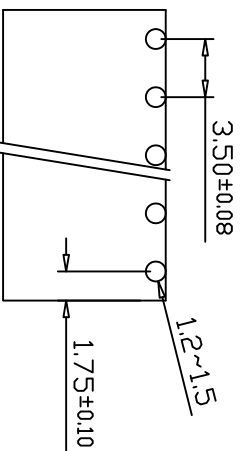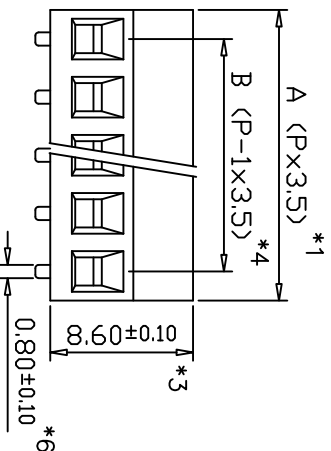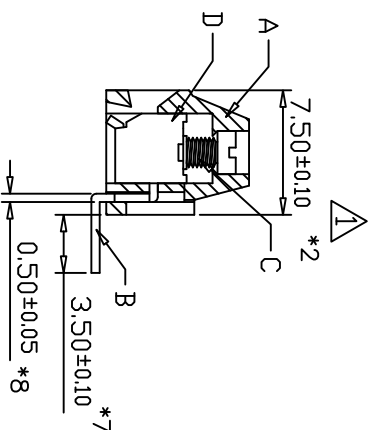

Size update From 7.60 to 7.50
(2018/10/17)

		HOW DER ELECTRONIC CO.,LTD		PART NAME Terminal Blocks		UNIT MM	REVISION
DESIGN	CHECK	APPROVED	DRAWING NO.	CERTIFIED			SHEET
DATE	DATE	DATE					
2009/09/03							1/1



http://www.howder-tn.com
E-mail:info@howder-tn.com

Tel:886-2-2223-1026
Fax:886-2-2221-6471