
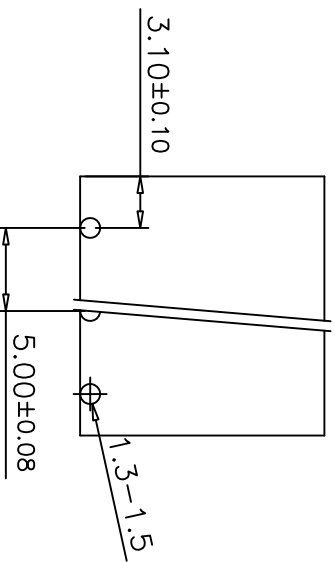
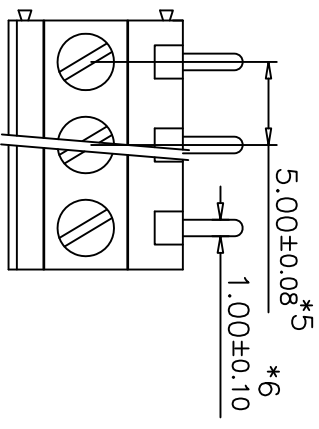
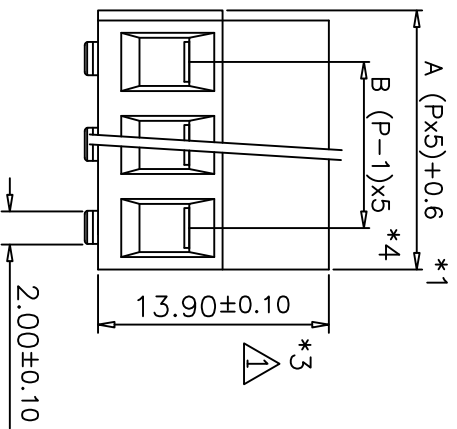


REVISION		DATE	APPROVED
ZONE	REV		

✓	Poles	A±0.30	B±0.20	17	85.60	80.0
02	10.60	5.0	18	90.60	85.0	
03	15.60	10.0	↓	Poles	A±0.45	B±0.35
04	20.60	15.0	19	95.60	90.0	
05	25.60	20.0	20	100.60	95.0	
06	30.60	25.0	21	105.60	100.0	
↓	Poles	A±0.35	B±0.25	22	110.60	105.0
07	35.60	30.0	23	115.60	110.0	
08	40.60	35.0	24	120.60	115.0	
09	45.60	40.0	↓	Poles	A±0.50	B±0.40
10	50.60	45.0	25	125.60	120.0	
11	55.60	50.0	26	130.60	125.0	
12	60.60	55.0				
↓	Poles	A±0.40	B±0.30			
13	65.60	60.0				
14	70.60	65.0				
15	75.60	70.0				
16	80.60	75.0				

Screws Torque: 3.5 In-Lb
Wire Range: 12~24 AWG
Rated: 20 Amperes,AC300V
Operation Temperature: -55°C~+100°C
Insulation withstands volt: AC2000V min
Insulation resistance: >1000MΩ/DC500V min
Part Number:

TS-503-XXP
02~26 Poles

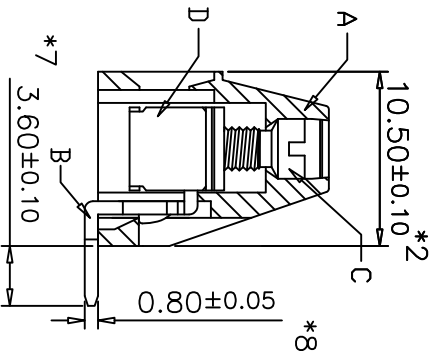

Size update From 13.85 to 13.90
(2019/04/12)



ELECTRONIC CO.,LTD

PART NAME
Terminal Blocks

UNIT
MM

REVISION

DESIGN	CHECK	APPROVED	DRAWING NO.	CERTIFIED	SHEET
DATE	DATE	DATE			1/1

http://www.howder-tn.com
E-mail:info@howder-tn.com

Tel:886-2-2223-1026
Fax:886-2-2221-6471

