


ZONE	REV	DESCRIPTION	DATE	APPROVED
------	-----	-------------	------	----------

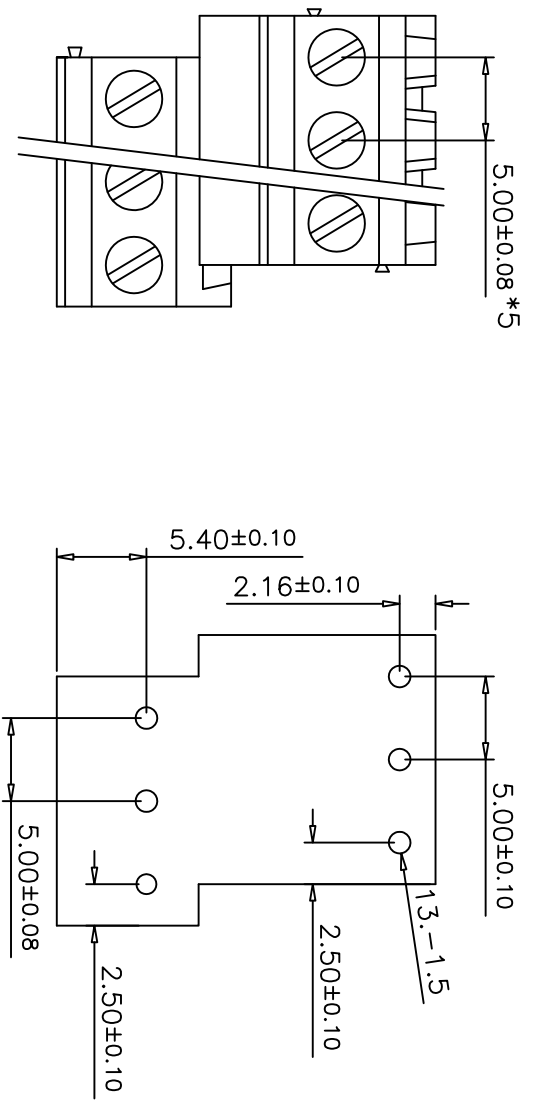


✓ Poles	A±0.30	B±0.20	17	87.5	80.0
02	12.5	5.0	18	92.5	85.0
03	17.5	10.0	↓ Poles	A±0.45	B±0.35
04	22.5	15.0	19	97.5	90.0
05	27.5	20.0	20	102.5	95.0
06	32.5	25.0	21	107.5	100.0
↓ Poles	A±0.35	B±0.25	22	112.5	105.0
07	37.5	30.0	23	117.5	110.0
08	42.5	35.0	24	122.5	115.0
09	47.5	40.0	↓ Poles	A±0.50	B±0.40
10	52.5	45.0	25	127.5	120.0
11	57.5	50.0	26	132.5	125.0
12	62.5	55.0			
↓ Poles	A±0.40	B±0.30			
13	67.5	60.0			
14	72.5	65.0			
15	77.5	70.0			
16	82.5	75.0			

Screws Torque: 7.0 In-Lb
 Wire Range: 16~22 AWG
 Rated: 10 Amperes, AC250V
 Operation Temperature: -55°C~+95°C
 Insulation withstands volt: AC2000V min
 Insulation resistance: >1000MΩ DC500V

Part Number:
 TS-500BLF-XXP

02~26 Poles

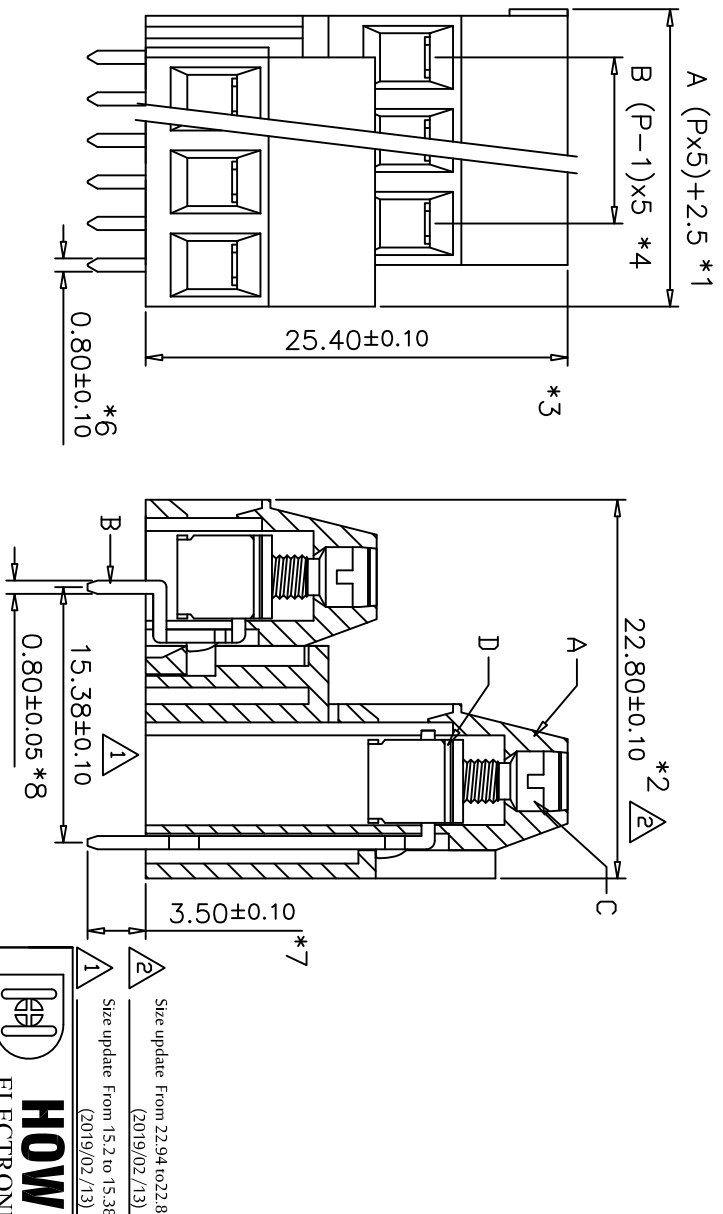

Material	Plating/Finish	Remark
A Insulating body PA66 UL 94V-0		Green
B Terminal Brass	Tin	
C Screw Steel	Zinc	M2.6
D Cage Clamp Brass	Nickel	
E		

Size update From 22.94 to 22.80
 (2019/02 /13)
 Size update From 15.2 to 15.38
 (2019/02 /13)

DESIGN	CHECK	APPROVED	DRAWING NO.	PART NAME	UNIT	REVISION
DATE	DATE	DATE		P.C.B Terminal Blocks	MM	
2009/09/03				CERTIFIED		SHEET
						1/1

