

ZONE	REV	DESCRIPTION	DATE	APPROVED
------	-----	-------------	------	----------

✓	Poles	A±0.30	B±0.20	17	142.05	132.0
02	18.30	8.25	18	150.30	140.25	
03	26.55	16.50	↓	Poles	A±0.45	B±0.35
04	34.80	24.75	19	158.55	148.50	
05	43.05	33.00	20	166.80	156.75	
06	51.30	41.25	21	175.05	165.0	
↓	Poles	A±0.35	B±0.25	22	183.30	173.25
07	59.55	49.50	23	191.55	181.50	
08	67.80	57.75	24	199.80	189.75	
09	76.05	66.00	↓	Poles	A±0.50	B±0.40
10	84.30	74.25	25	208.05	198.0	
11	92.55	82.50	26	216.30	206.25	
12	100.8	90.75	27	224.55	214.50	
↓	Poles	A±0.40	B±0.30	28	232.80	222.75
13	109.05	99.00	29	241.05	231.00	
14	117.30	107.25	30	249.30	239.25	
15	125.55	115.50	31	257.55	247.50	
16	134.28	123.75	32	265.80	255.75	

Screws Torque: 12 In-Lb

Wire Range: 16~22 AWG

Rated: 20 Amperes, AC300V

Operation Temperature: -55°C~+95°C




Insulation withstands volt: AC2000V min

Insulation resistance: >1000MΩ DC500V

Part Number:

FTB-801-XXP

02~32 Poles

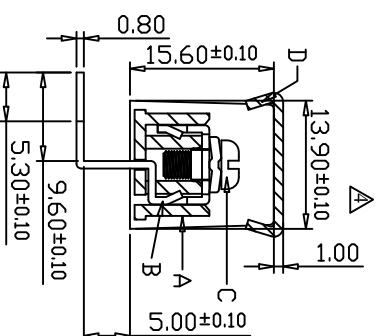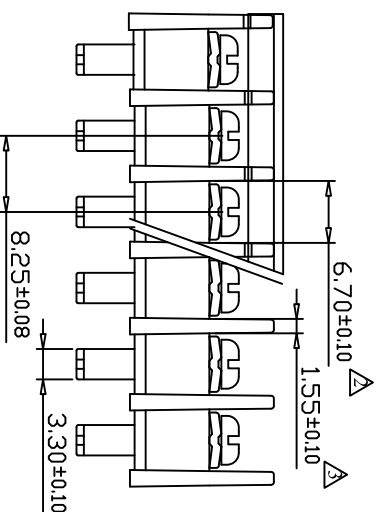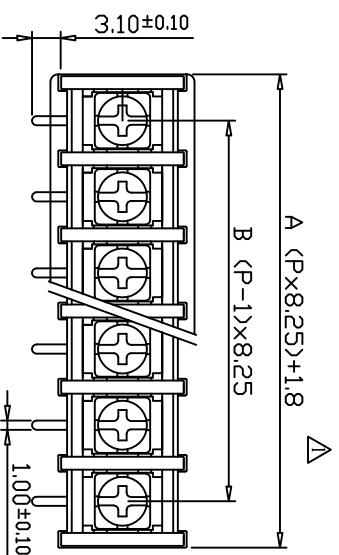

- Size update From 14.0 to 13.9 (2017/08/09)
- Size update From 1.65 to 1.55 (2017/08/09)
- Size update From 6.6 to 6.7 (2017/08/09)
- Size update From 1.65 to 1.80 (2017/08/09)



HOW DER
ELECTRONIC CO.,LTD

PART NAME
Terminal Blocks

UNIT
MM

REVISION

DESIGN	CHECK	APPROVED	DRAWING NO.
DATE	DATE	DATE	

CERTIFIED



SHEET
1/1

