


ZONE	REV	DESCRIPTION	DATE	APPROVED

✓ Poles	A±0.30	B±0.20
02	15.50	10.0
03	25.50	20.0
04	35.50	30.0
05	45.50	40.0
06	55.50	50.0
↓ Poles	A±0.35	B±0.25
07	65.50	60.0
08	75.50	70.0
09	85.50	80.0
10	95.50	90.0
11	105.50	100.0
12	115.50	110.0

Screws Torque: 7.0 In-Lb  
 Wire Range: 14~18 AWG  
 Rated: 15 Amperes, AC250V  
 Operation Temperature: -55°C~+100°C  
 Insulation withstands volt: AC2000V min  
 Insulation resistance: >1000MΩ/DC500V

Part Number:  
 TS-504-10-XXP

02~23 Poles

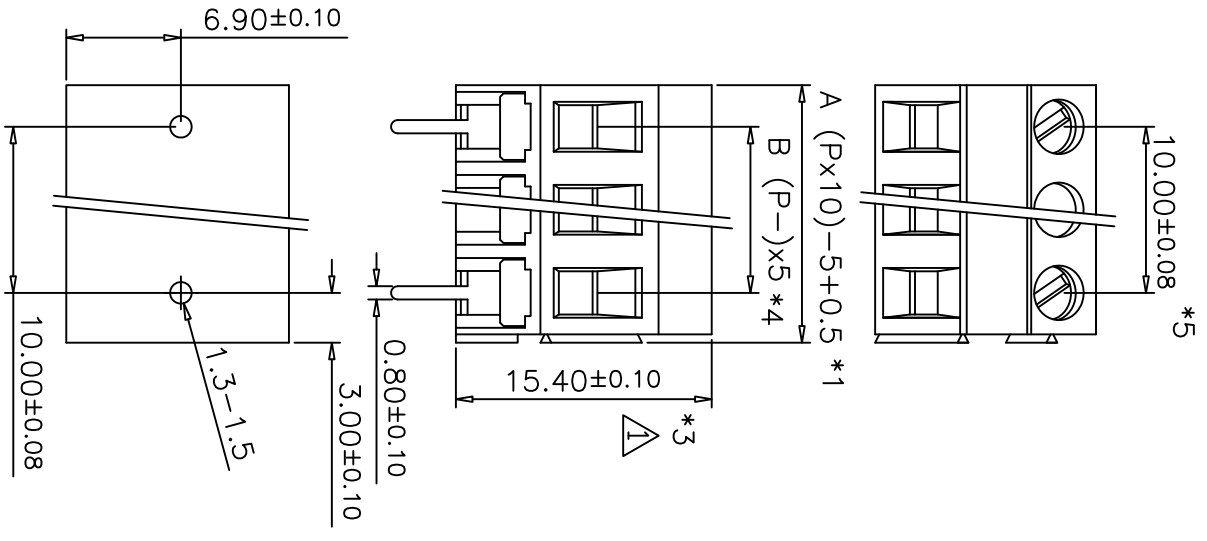

Size update From 13.4 to 13.3 (2019/04/12)  
 Size update From 15.34 to 15.40 (2019/04/12)

Material	Remark
A Insulating body PA66 UL 94V-0	Plating/Finish Green
B Terminal Brass	Tin
C Screw Steel	Zinc
D Clamp Brass	Nickel
E	

		<b>HOW DER</b> ELECTRONIC CO., LTD		PART NAME Terminal Blocks		UNIT MM		REVISION SHEET 1/1	
DESIGN DATE	CHECK DATE	APPROVED DATE	DRAWING NO.	CERTIFIED					
2009/09/03									



http://www.howder-ek.com  
 E-mail:info@howder-ek.com  
 Tel:896-2-2223-1026  
 Fax:896-2-2221-6471